


Surge Protection Barrier

FN-LB-I



- 1-channel
- Field mount module
- 1/2 NPT thread
- Stainless steel housing
- Max. surge current (8/20 μ s) 20 kA
- 500 V isolation from earth
- Suitable for hazardous area
- Up to SIL 3 acc. to IEC/EN 61508

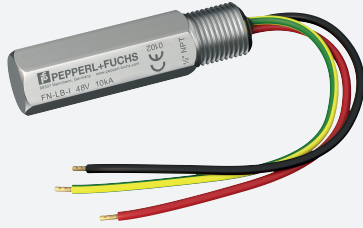

Function


This Surge Protection Barrier limits induced transients of different origin (e. g. lightning stroke, switching impulse, etc.). This is achieved by diverting the transient current to ground and limiting the signal line voltage to a safe level for the duration of the surge. This barrier provides 85 V line-to-line and 500 V line-to-ground clamping voltage for the protected instruments. It also protects instruments that have less than 500 V isolation-to-ground.

It is installed in an available conduit or cable gland opening like those found on most process transmitters.

For additional information, refer to the manual and www.pepperl-fuchs.com.

Note: Surge Protection Barriers must always be connected to a solid and effective ground and be at the same equipotential level as the instrument it is protecting. The ground system must comply with all applicable regulations.

Connection

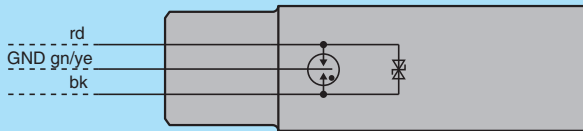

Ex Zone 1, 2
Div. 1, 2

Technical Data

General specifications

Number of protected signal lines 1

Functional safety related parameters

Safety Integrity Level (SIL) SIL 3

Supply

Rated voltage $U_r \leq 48$ V

Rated current $I_r \leq 250$ mA


Leakage current ≤ 5 μ A

On-state voltage ≤ 85 V

Technical Data

Ground insulation	≥ 500 V breakdown voltage		
Electrical specifications			
Total discharge current (8/20 μs)	I_{total}	20 kA	
Conformity			
Degree of protection	IEC 60529:2001		
Ambient conditions			
Ambient temperature	-30 ... 60 °C (-22 ... 140 °F) For usage in hazardous area observe EC-type examination certificate.		
Mechanical specifications			
Housing material	Stainless steel 1.4401 (AISI 316) surface all over polished		
Degree of protection	IP67		
Cable			
Length	L	0.3 m	
Mass	approx. 200 g		
Dimensions	AF22 x 77 mm (0.9 x 3 inch)		
Mounting	NPT1/2 thread		
Data for application in connection with hazardous areas			
EU-type examination certificate	PTB 00 ATEX 2175		
Marking	⊕ II 2G EEx ia IIC T6		
Voltage	U_i	50 V	
Maximum leakage current	10 kA line to ground (common), 5 kA line to line (differential) in accordance to IEC 60-2		
Nominal response time			
Symmetrical	1 ns		
Asymmetric	100 ns		
Bandwidth	≥ 40 kHz		
Directive conformity			
Directive 2014/34/EU	EN 60079-0:2012+A11:2013 , EN 60079-11:2012		
International approvals			
CSA approval			
Control drawing	116-0187 (cCSAus)		
General information			
Supplementary information	EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com .		

Assembly

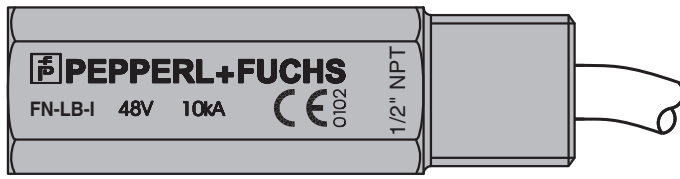

Release date: 2022-01-12 Date of issue: 2022-01-12 Filename: 098918_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com


Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com

Connection

Installation examples

Terminal box

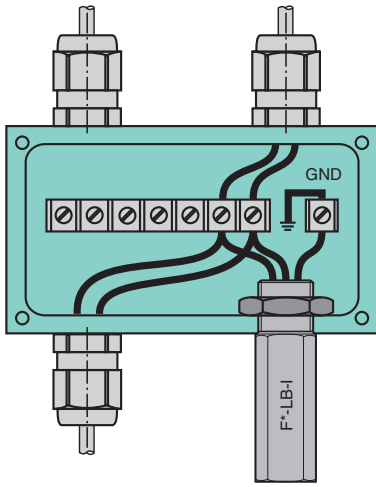

Transmitter

